


Data Sheet 3

Test Number :	4	Air temperature:	16.9°C
Client:	Norseal	Air humidity:	49%
Test Date:	17/11/2009	Receiving room volume:	300m ³
Sample height:	2.084m	Source room volume:	55m ³
Sample width:	0.994m	Sample weight:	27.3kg/m ²
Product	54mm Silentdor timber door in softwood frame with seals		
Identification:	Head and jambs Norsound 710 Block stiles & head Norsound 720 (hinges 710) Threshold Norsound 810 with Norsound 625 threshold strip and Norsound 815 dropseal		

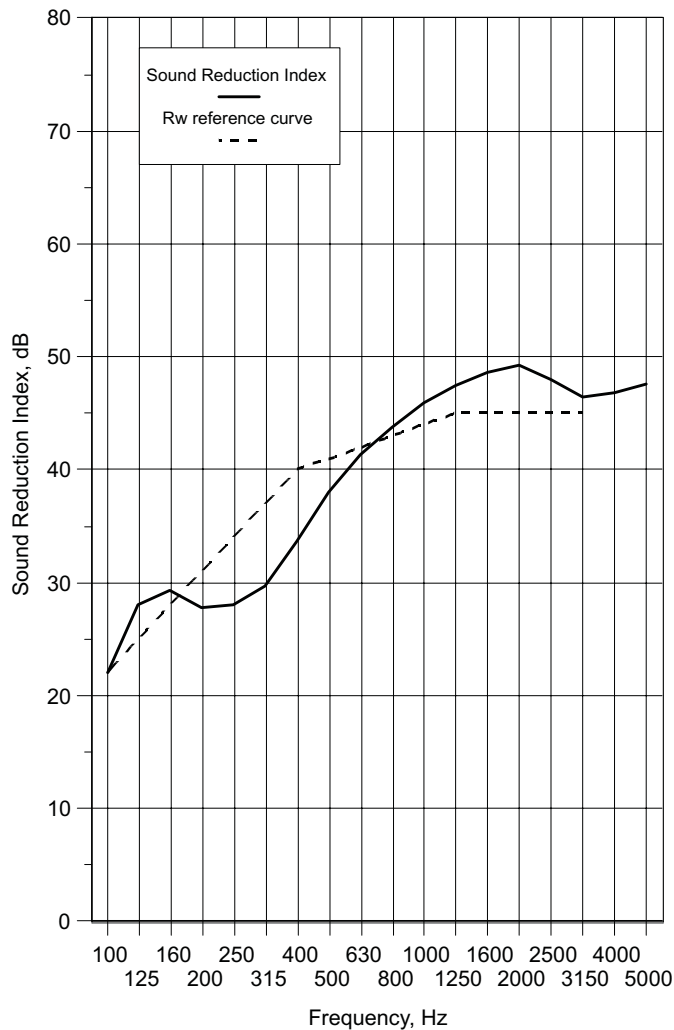

Rating according to BS EN ISO 717-1:1997

Rw(C;Ctr)= **41 (-2;-6)** dB

Notes: * designates measurement corrected for background

designates limit of measurement due to background

+ designates frequency beyond standard and not UKAS accredited

v1.6

