


Data Sheet 6

Test Number :	7	Air temperature:	16.9°C
Client:	Norseal	Air humidity:	49%
Test Date:	17/11/2009	Receiving room volume:	300m ³
Sample height:	2.084m	Source room volume:	55m ³
Sample width:	0.994m	Sample weight:	27.3kg/m ²
Product	54mm Silentdor timber door in softwood frame with seals		
Identification:	Head and jams Norsound 710 Block stiles and head Norsound 720 (hinges 710). Threshold Norsound 810 and Norsound 650		

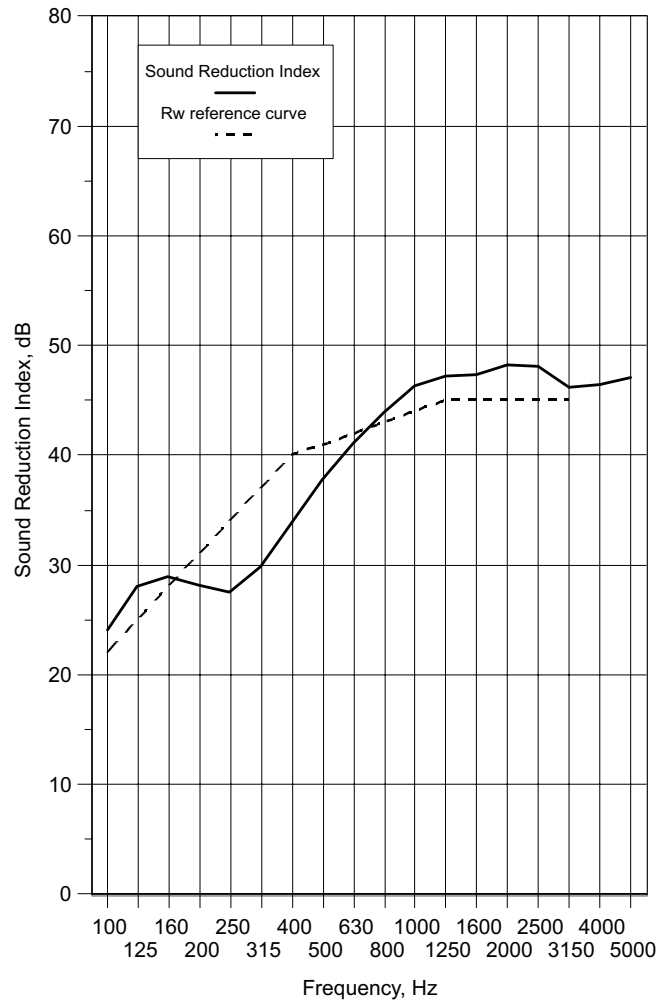

Rating according to BS EN ISO 717-1:1997

Rw(C;Ctr) = **41 (-2;-5) dB**

Notes: * designates measurement corrected for background

designates limit of measurement due to background

+ designates frequency beyond standard and not UKAS accredited

v1.6

